


GUIDELINES

1. ALL INSTALLATIONS REQUIRE A TRADE WASTE PERMIT.
2. ALL SEPARATORS ARE TO BE SIZED ACCORDING TO RATE OF FLOW.
3. SEPARATORS TO BE INSTALLED IN A BUNDED AREA.
4. DRAIN FROM BUNDED AREA TO DISCHARGE TO HOLDING TANK.
5. MINIMUM SIZE OF SAMPLING POINT TO BE DN100 IN ACCORDANCE WITH TRADE WASTE TYPICAL DRAWING HX33-11-30.
6. MANUAL START AND AUTOMATIC SHUT OFF FOR PUMP.
7. HOLDING TANK DESIGN SHOULD CONSIDER APPROPRIATE TYPE AND SIZE OF VENTING & MEET REQUIREMENTS OF LATEST VERSION OF AS/NZS 3500.2
8. MANUAL PUMP START TO BE LOCATED ADJACENT TO HOLDING TANK.
9. ALL MEASUREMENTS SHOWN ARE IN MILLIMETRES.
10. ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) (AS AMENDED)
11. OIL WATER SEPARATOR TO BE A WATER CORPORATION APPROVED PRODUCT. REFER WATER CORPORATION WEBSITE FOR LIST OF APPROVED PRODUCTS.

LEGEND

- GL GROUND LEVEL
- TWSP TRADE WASTE SAMPLE POINT

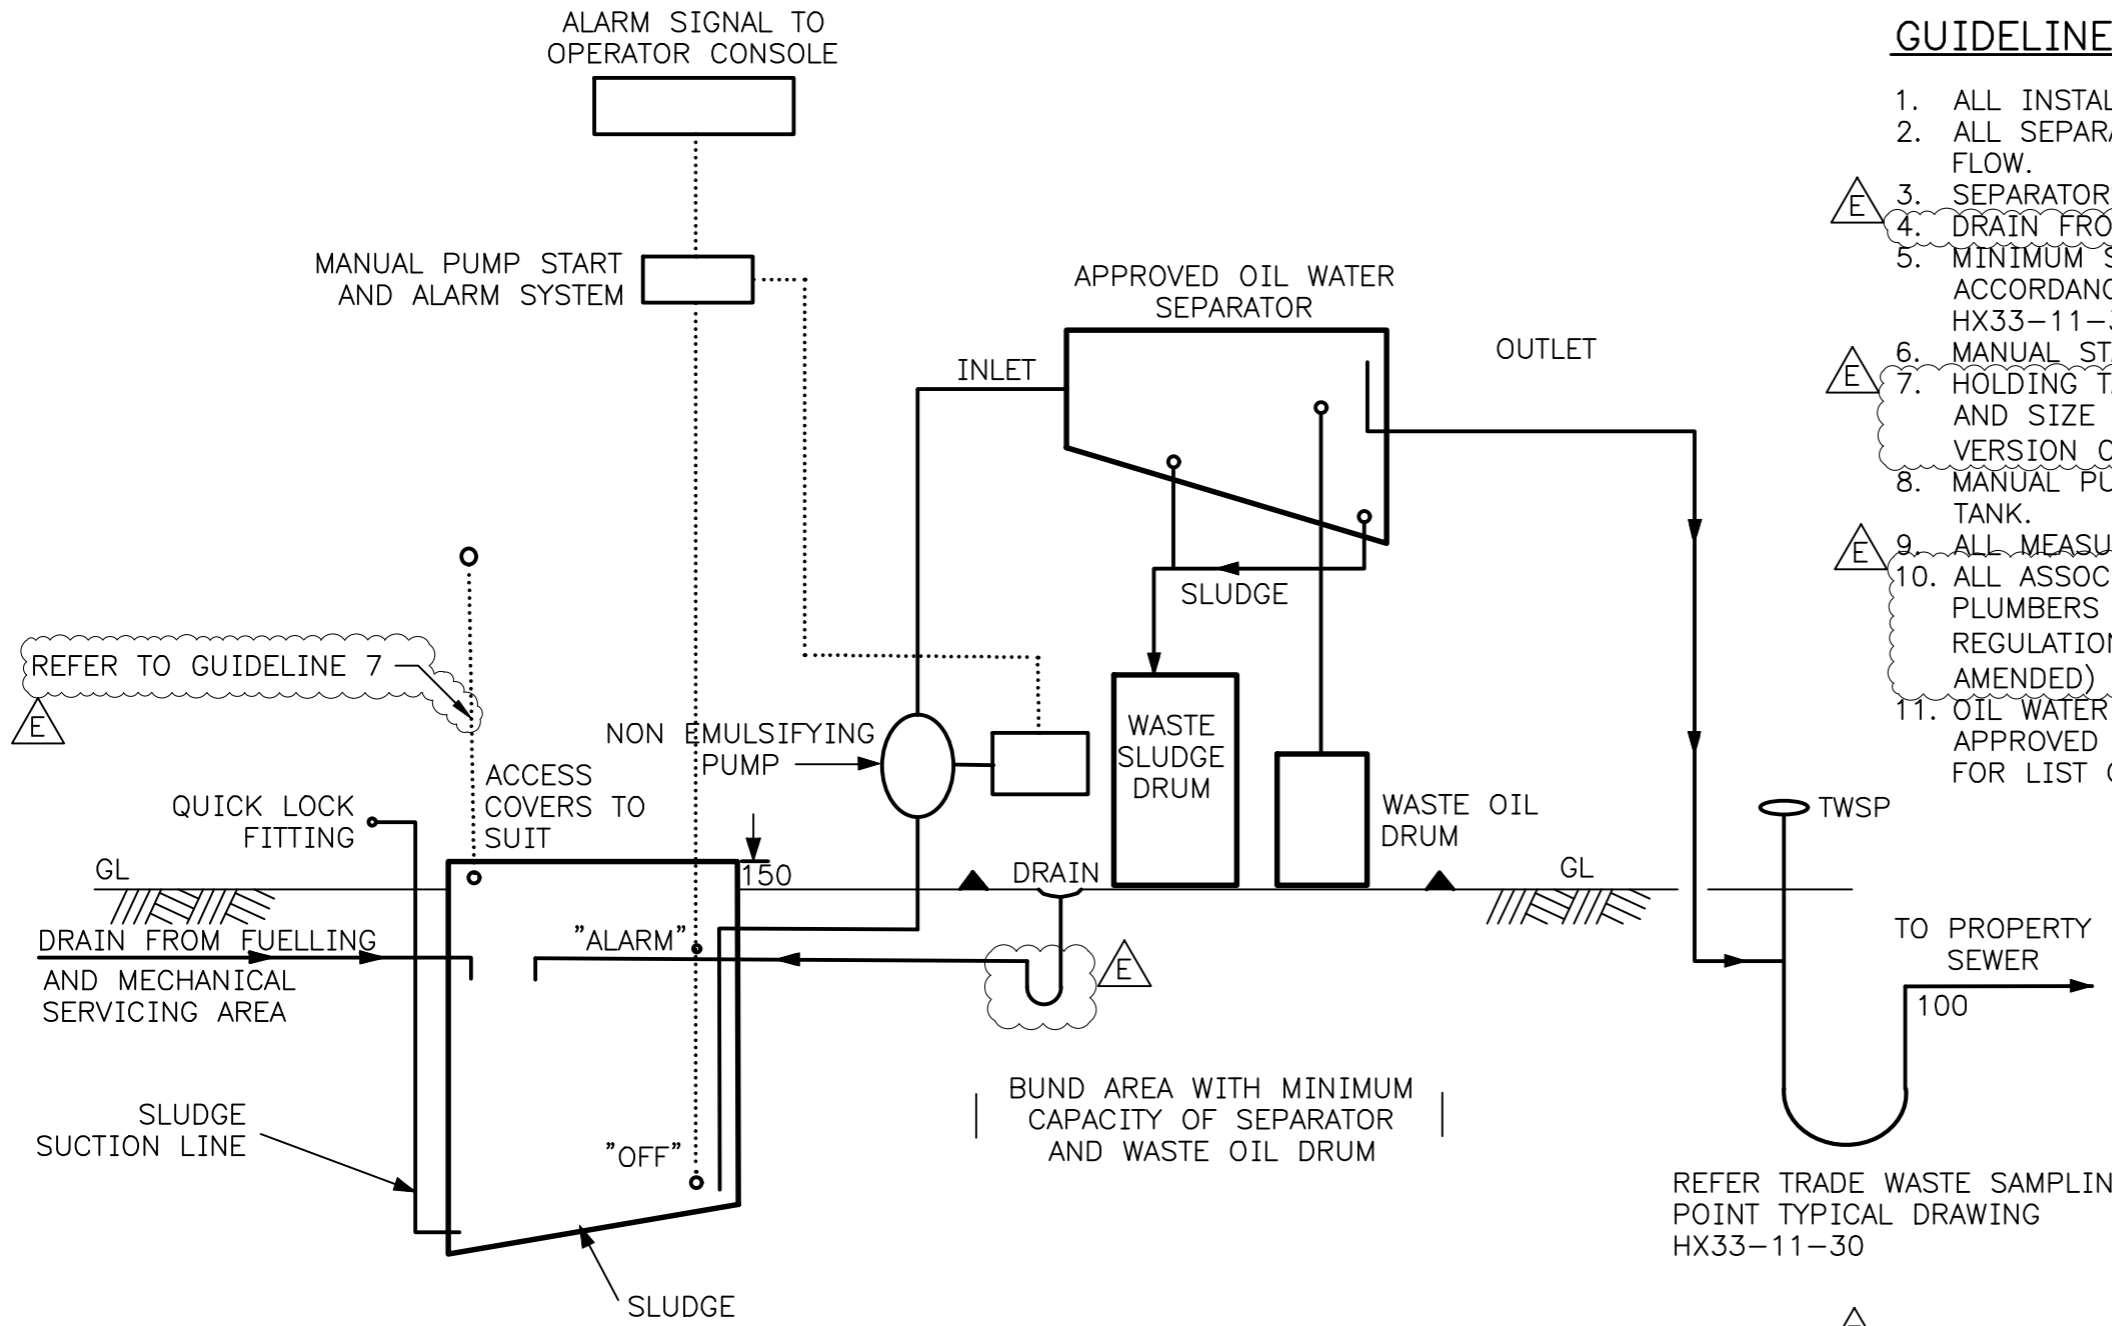

HOLDING TANK
 MIN CAPACITY 1000 LITRES
 BUT NOT LESS THAN DOUBLE THE CAPACITY OF
 THE APPROVED SEPARATOR'S HOLDING CAPACITY

12. ALL ASSOCIATED ELECTRICAL CONNECTIONS TO COMPLY TO AUSTRALIAN STANDARDS AND TO BE INCORPORATED INTO ANY TREATMENT SYSTEM DESIGN
13. ALL ELECTRICAL CONNECTIONS TO BE CERTIFIED BY A LICENSED TRADES PERSON OR ELECTRICIAN WATER CORP DOES NOT CERTIFY ELECTRICAL
14. ACCESS COVERS TO BE GAS TIGHT AND TO COMPLY TO LATEST VERSION OF AS 3996

FOR MORE INFORMATION REFER TO OUR WEBSITE watercorporation.com.au/tradewaste

SCALE: DIAGRAMMATIC

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD
E	05/2024		NOTE 7 UPDATED, NOTE 12,13 AND 14 ADDED, TRAP ADDED FROM DRAIN	JD	NT	MS
D	02/2020		PLUMBING REGULATION TITLE UPDATED, NOTE 12 ADDED, FORMERLY TYPICAL DRAWING REFERENCE REMOVED, WASTE SLUDGE DRUM ADDED	JMS	NT	MS
C	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AND LEGEND AMENDED	BJ	SJ	MS
B	06/2009		NOTE 11 ADDED	RJ	GC	AM

DES CALC	RECOMMENDED	01/08/2005		WATER CORPORATION		ORIGINAL SHEET SIZE
DES CHD	A MANZINGER			TYPICAL DRAWINGS FOR TRADE WASTE		
DRN	APPROVED	01/08/2005	J HEWITT		FILE	58584-700
A CLEAVER	MANAGER, INDUSTRIAL WASTES		PROJECT		PLAN	HX33-12-30
Q.C. CHD					CAD	ISSUE
G CLEAVER						E